

## Axiom V Door Release from a single input

1. Select one of your spare inputs and set up as per below. Normally open or normally closed  
Depending on fire alarm setup.

Input Properties

Name  
Door Release Input

General Links

General Purpose Abort Delay  
0 Sec


Circuit Type  
NO, No Resistor  Forced Arm Alarm


Disarm Schedule  
0 ...

Enabled

OK Cancel


2. Set up an access point group containing the doors you wish to release. (the same principal can be used to set up door release on a single controller if you have an input at each Controller)

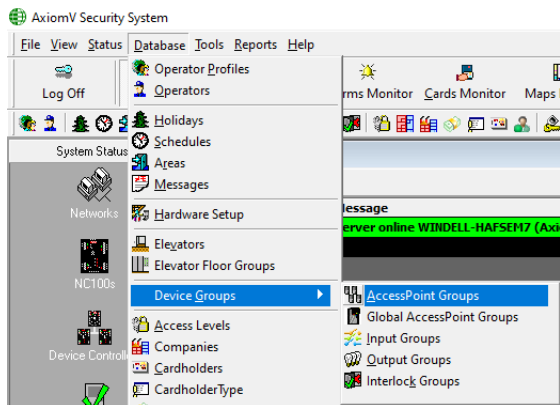

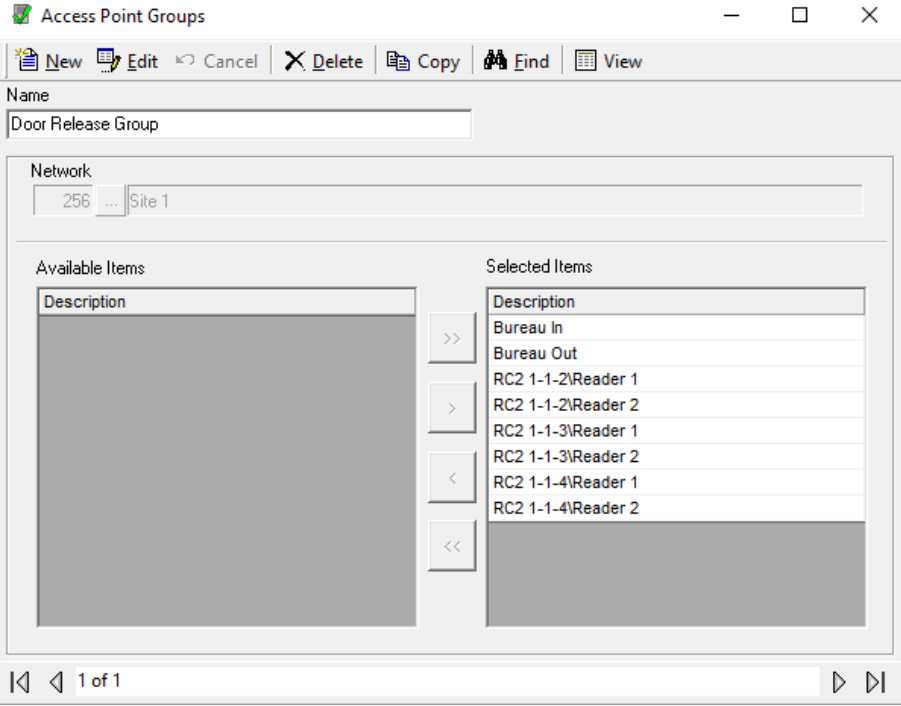


3. Set up 2 Axiomlinks from Database – AxiomLinks.


One for release.

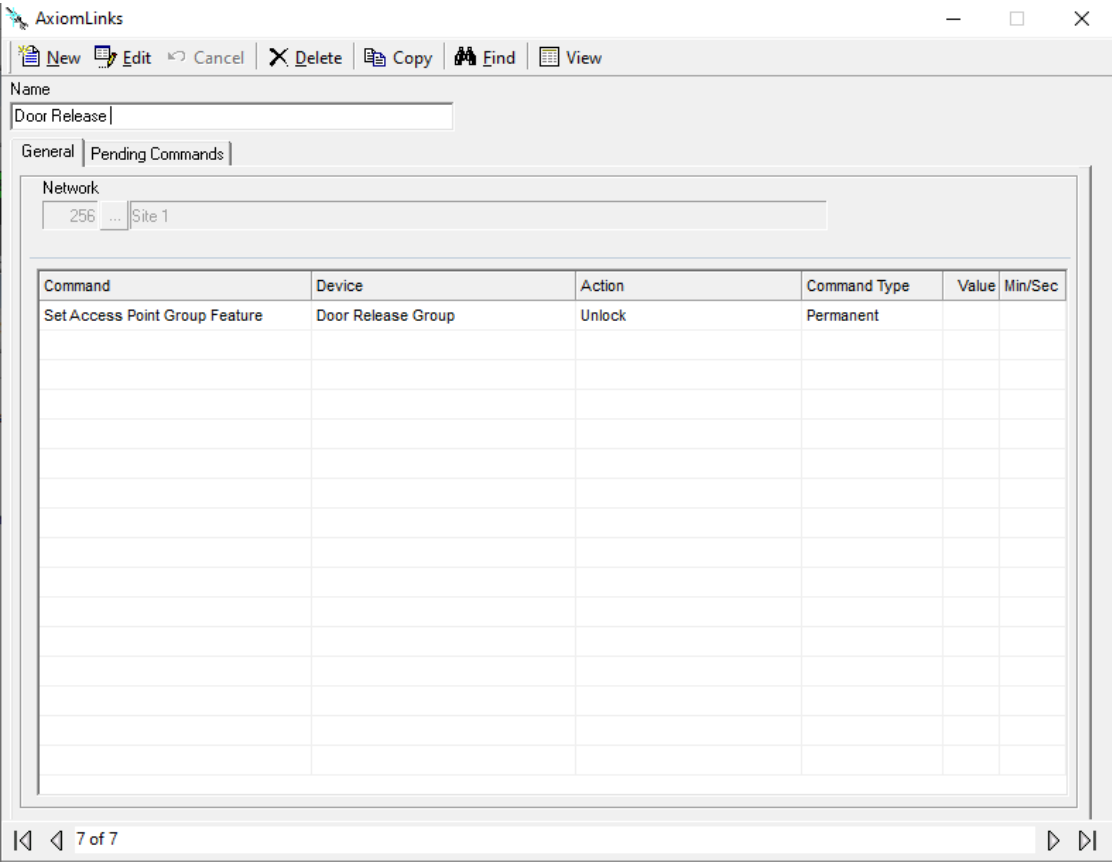

And one for reset.

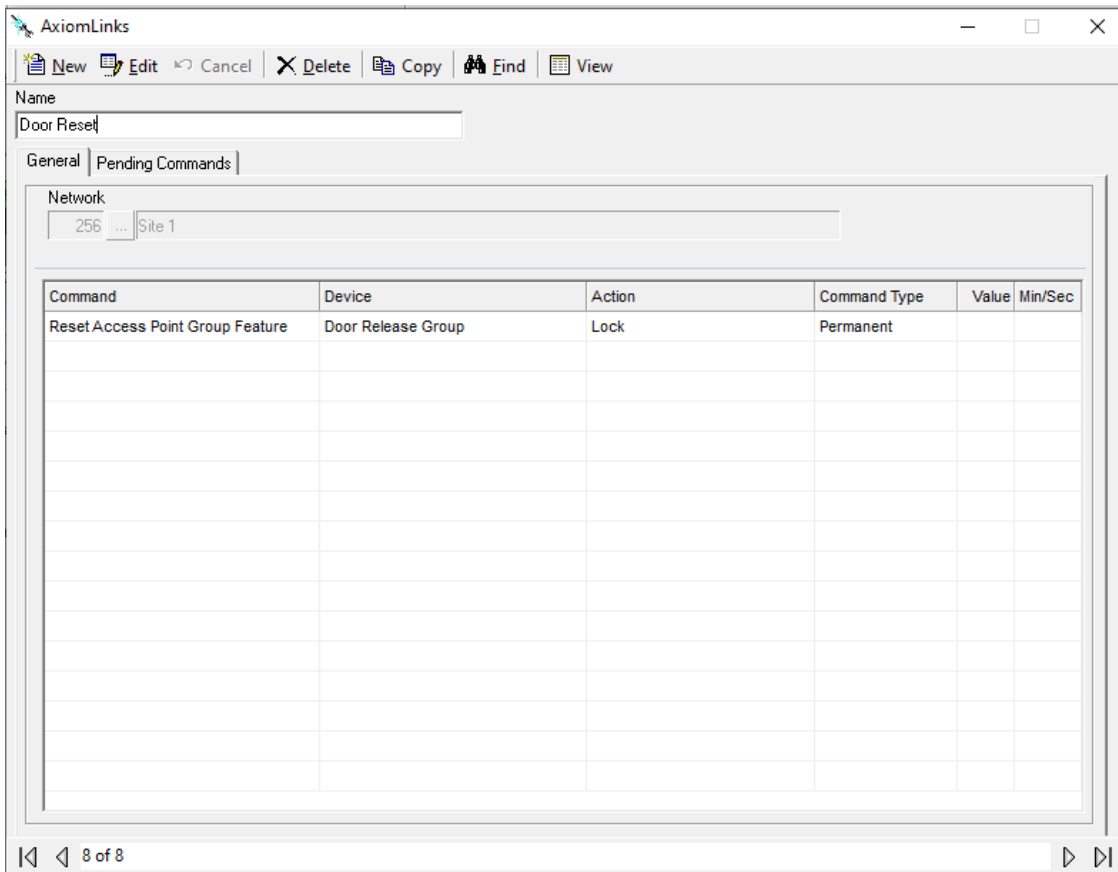

4. Attach the new links to the Door release input.

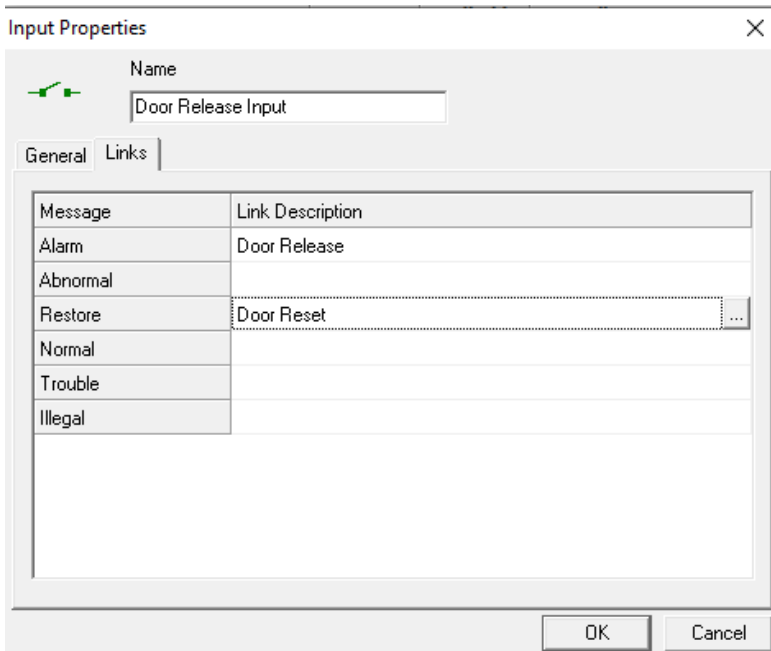

5. Under monitoring of the input, make sure Alarm and Restore have no event blocking Schedule and that block event logging to history is unticked.

